
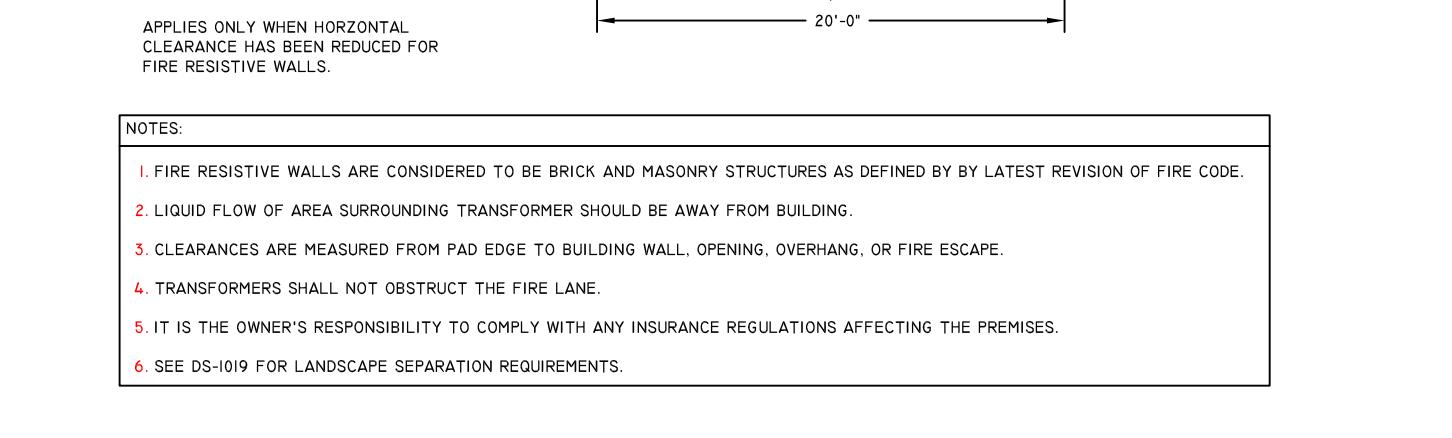
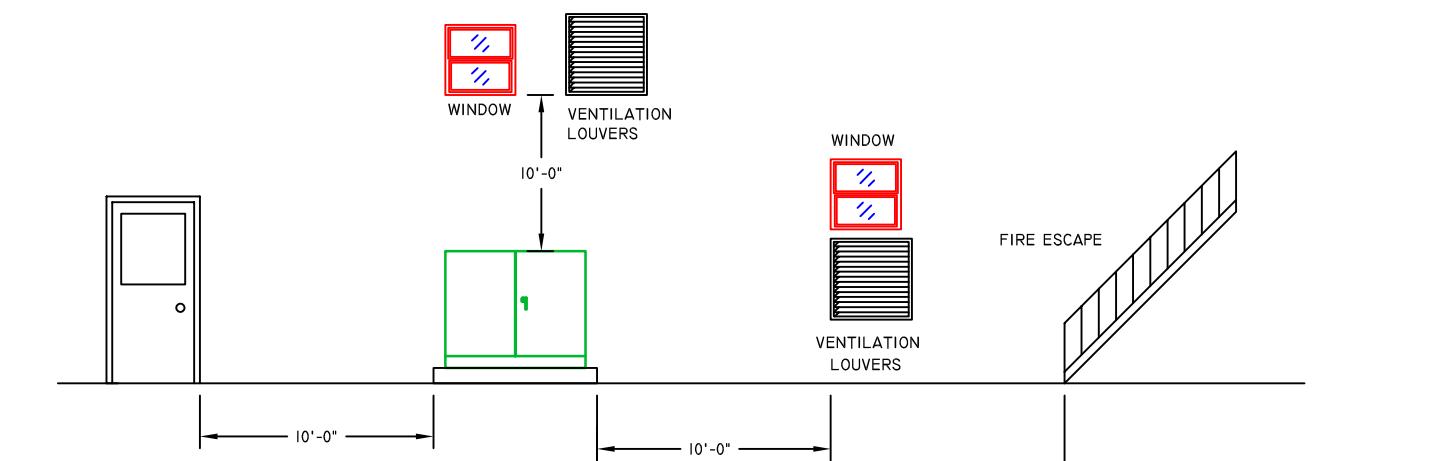
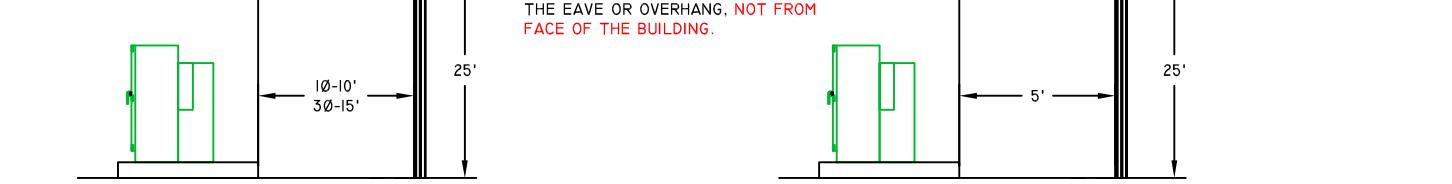
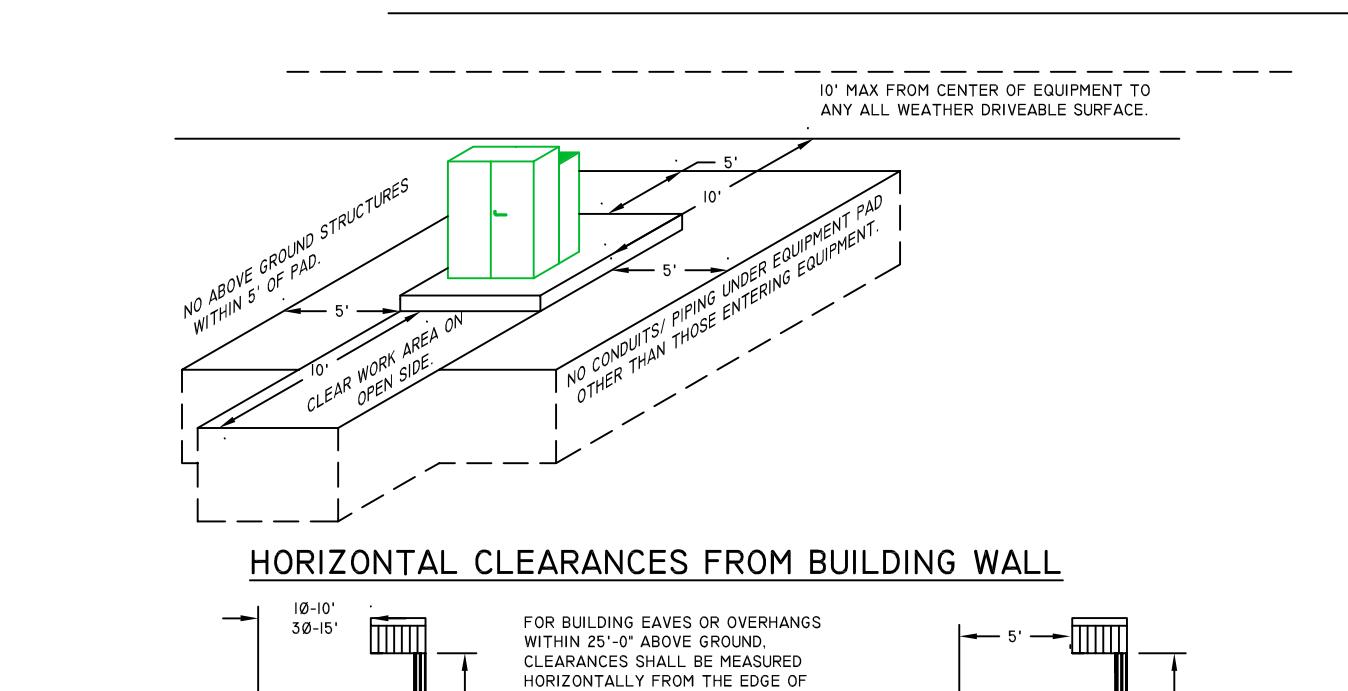
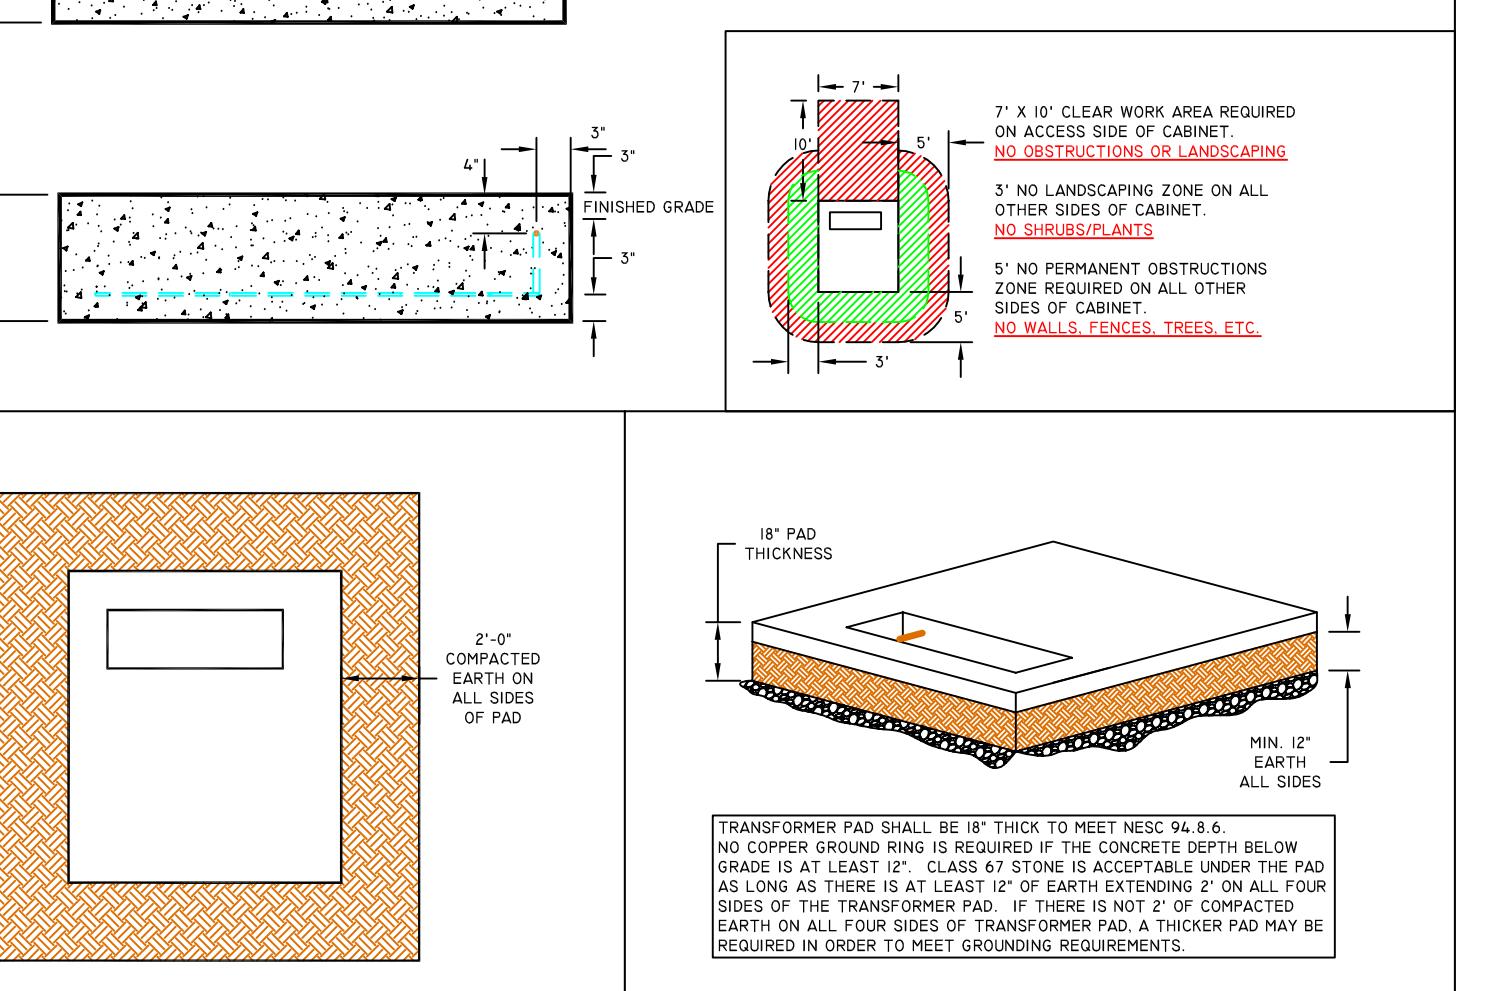
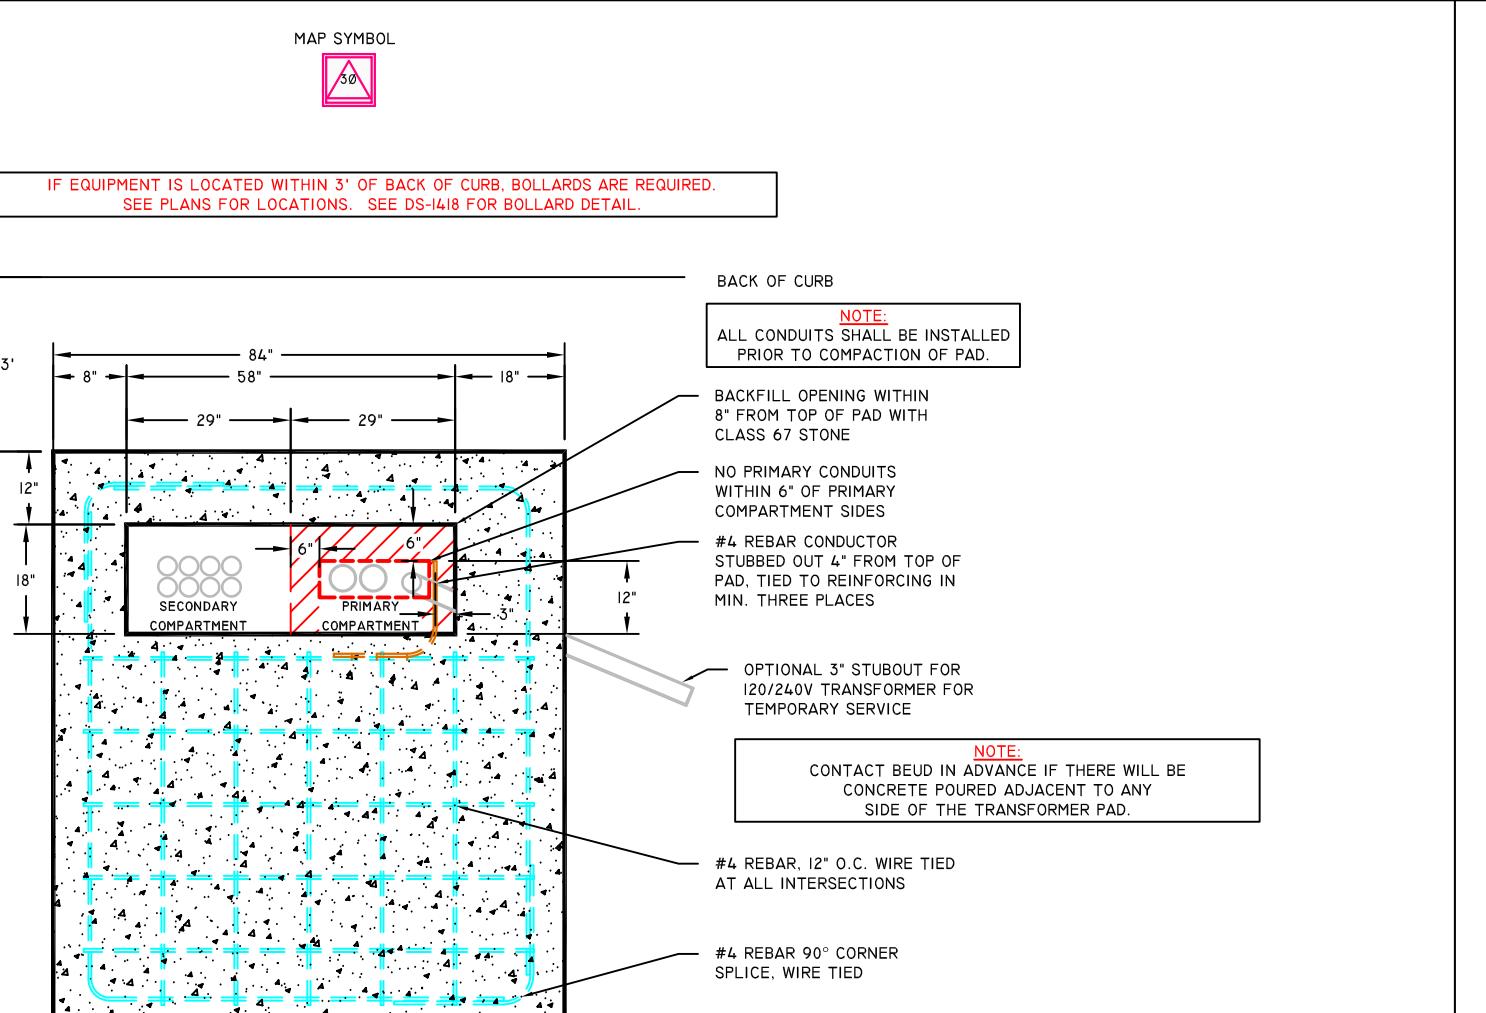
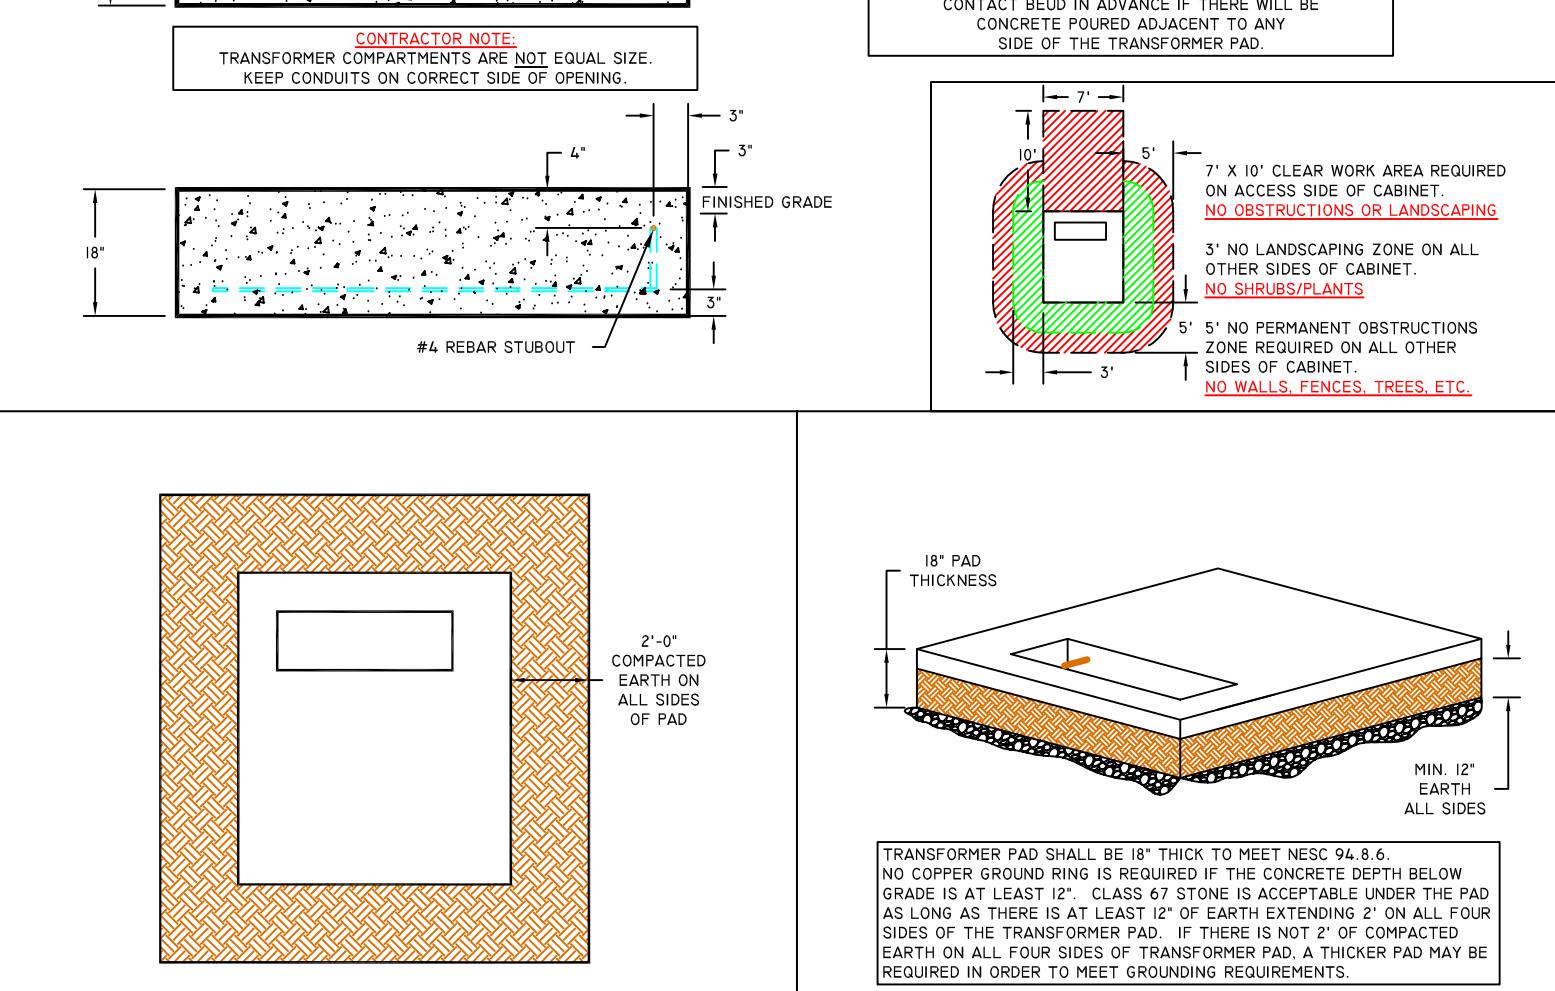
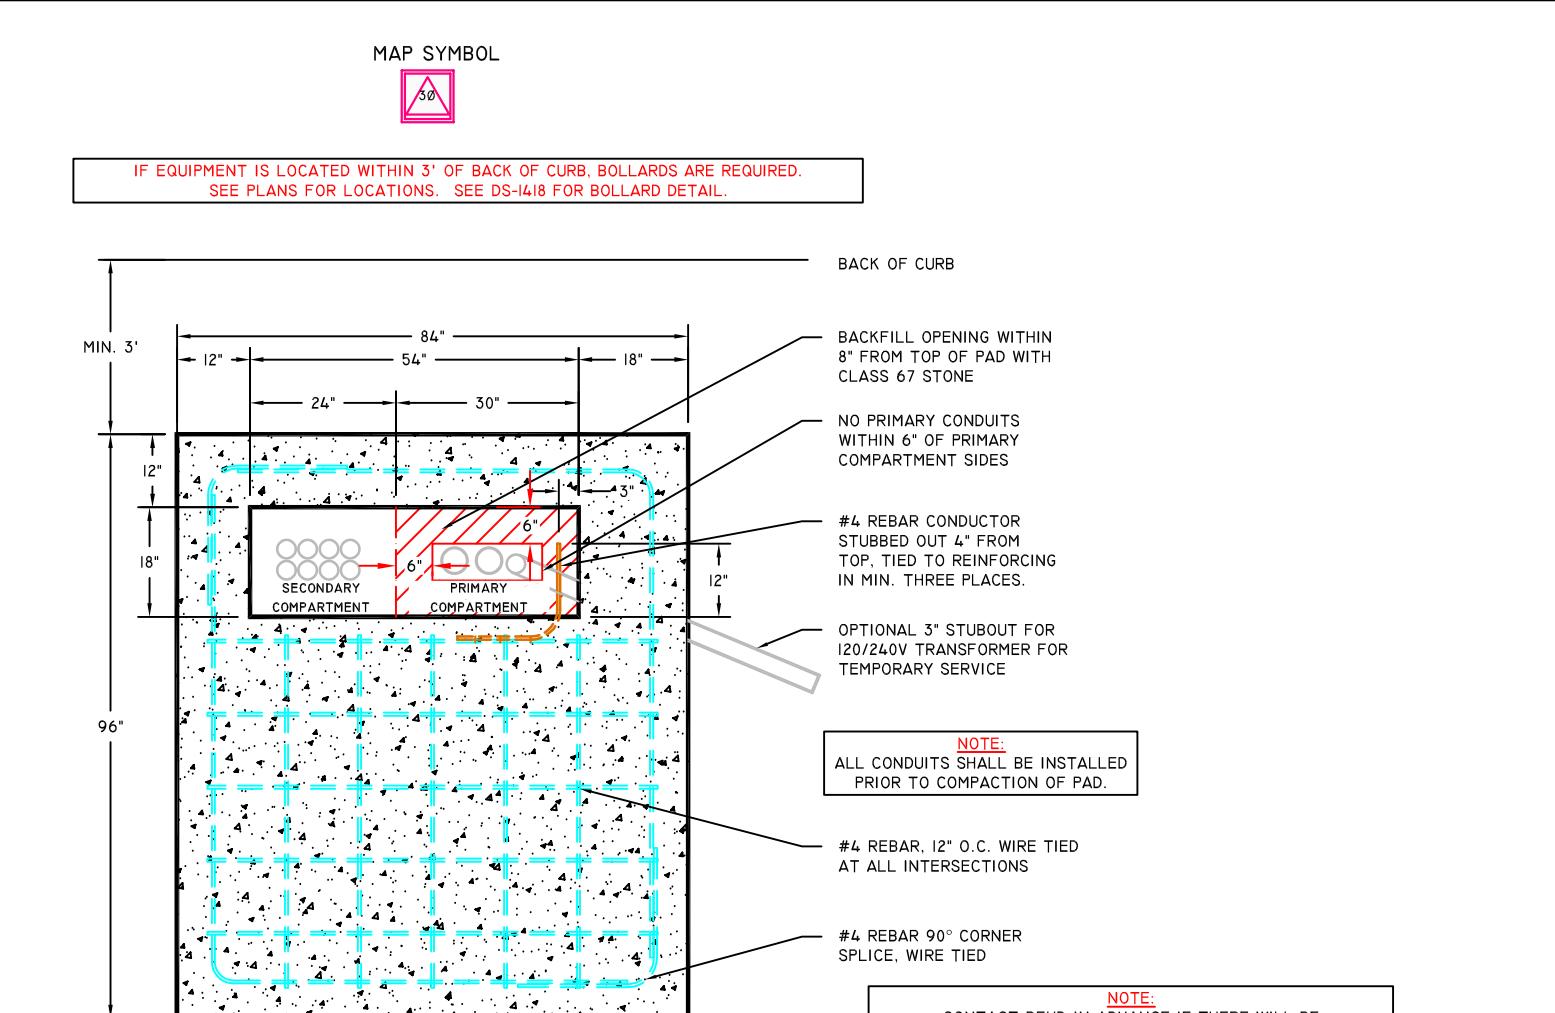


DS-I403 ELECTRIC TRENCH DETAILS SHEET I

DS-I404 ELECTRIC TRENCH DETAILS SHEET 2

# S-1405 SINGLE PHASE TRANSFORMER SITE REQUIREMENTS

# 6-I406 SINGLE PHASE TRANSFORMER PAD SMALLER THAN 100 kVA

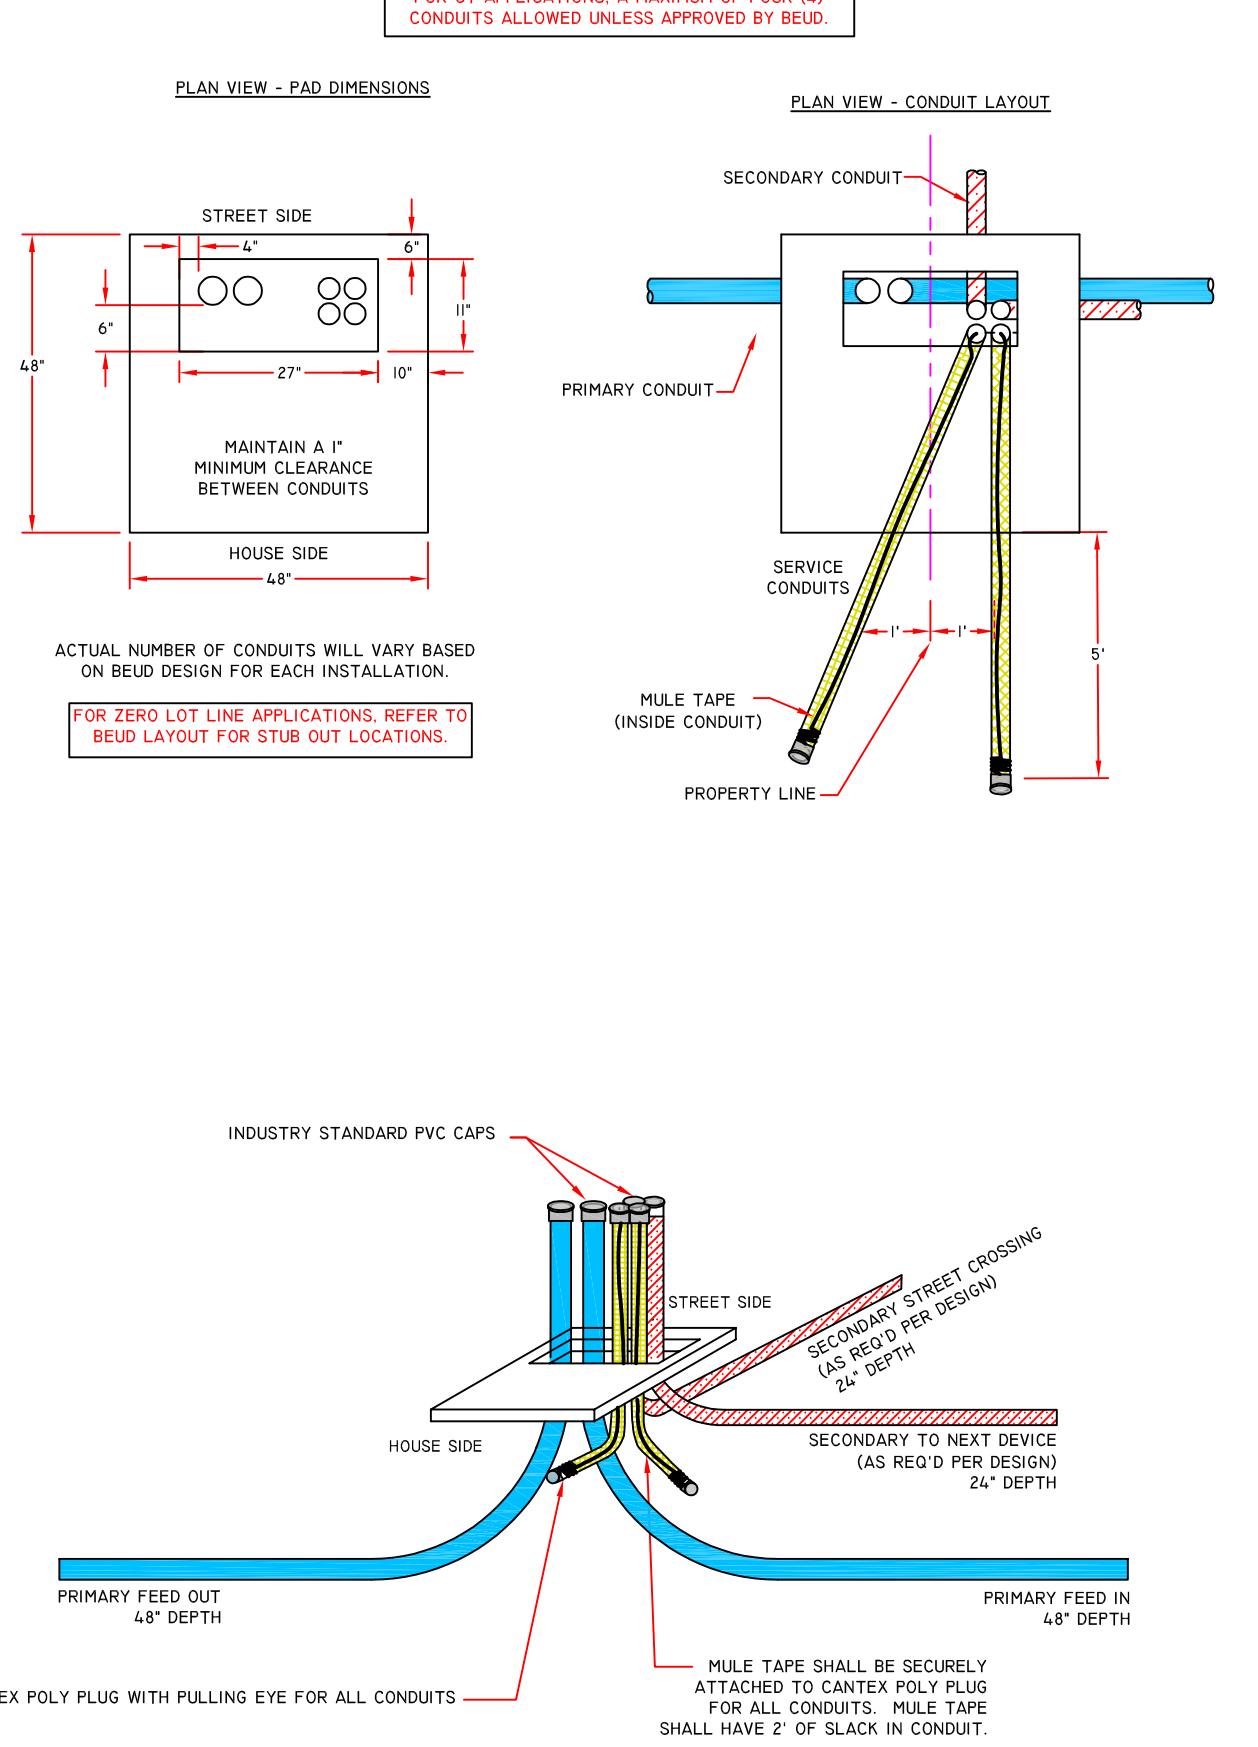

# DS-1407 SINGLE PHASE TRANSFORMER PAD 100 kVA AND LARGER

# DS-I408 THREE PHASE TRANSFORMER PAD 45-1000 KVA

S-1409 THREE PHASE TRANSFORMER PAD  
1500-2500 kVA

# OS-1410 CLEARANCE SPECIFICATIONS FOR PADMOUNTED EQUIPMENT